


PARTIAL SIXTH FLOOR MECHANICAL ROOM DEMOLITION PLAN - HVAC
SCALE: 1/4" = 1'-0"

DEMOLITION KEYED NOTES:

- 1 REMOVE AND DISCARD THE EXISTING AIR HANDLING UNITS (AHU-6 & 9) COMPLETE WITH ALL PIPING, DUCT CONNECTIONS, INSULATION, CONTROLS AND ASSOCIATED APPURTENANCES COMPLETELY.
 - 2 REMOVE AND DISCARD THE EXISTING RETURN AIR FANS RF-6 & 9 COMPLETE WITH DUCT CONNECTIONS, INSULATION, CONTROLS AND ASSOCIATED APPURTENANCES COMPLETELY.
 - 3 REMOVE AND DISCARD ALL EXISTING DUCTWORK SHOWN (HEAVY AND DASHED) COMPLETE WITH INSULATION, HANGERS, DAMPERS AND ALL ASSOCIATED APPURTENANCES.
 - 4 REMOVE AND DISCARD OF EXISTING PIPING SHOWN (HEAVY AND DASHED) TO BE REMOVED COMPLETE WITH INSULATION, HANGERS, VALVES AND ALL ASSOCIATED APPURTENANCES.
 - 5 REMOVE AND DISCARD OF EXISTING CIRCULATOR PIPING SHOWN (HEAVY AND DASHED) COMPLETE WITH HANGERS, VALVES AND ALL ASSOCIATED APPURTENANCES.
 - 6 CAP EXISTING LOUVER WITH 14GA SHEETMETAL INSULATED WITH 4" FOAM BOARD. SEAL WITH VENTURE CLAD TYPE SYSTEM AIRTIGHT.
 - 7 REMOVE AND DISCARD EXISTING WALL THERMOSTAT THAT CURRENTLY OPERATES AHU-6. PROVIDE NEW DDC SENSOR IN SAME LOCATION AS THE EXISTING THERMOSTAT AND TIE INTO SIEMENS CONTROL SYSTEM FOR NEW VAV BOX (G-VAV-1). REFER TO SEQUENCE OF OPERATIONS IN THE AUTOMATIC TEMPERATURE CONTROLS SPECIFICATION. MANUAL FOR THIS PROJECT.
- (E) EXISTING
ETR EXISTING TO REMAIN

GENERAL MECHANICAL DEMOLITION NOTES:

- UNDER DEMOLITION, THE FOLLOWING IS, IN BRIEF, THE EXTENT OF THE WORK TO BE PERFORMED BY THE MECHANICAL CONTRACTOR UNDER THIS CONTRACT:
1. CONTRACTOR SHALL VISIT SITE AND IDENTIFY EXISTING CONDITIONS AND DIFFICULTIES THAT WILL AFFECT WORK OF THIS SECTION. DEMOLITION WORK WILL REQUIRE CAREFUL SITE EXAMINATION PRIOR TO BIDDING.
 2. ALL DEMOLITION WORK SHALL BE PERFORMED IN ACCORDANCE WITH STATE AND LOCAL REGULATIONS. CONTRACTOR SHALL SECURE ALL REQUIRED DEMOLITION PERMITS.
 3. PRIOR TO COMMENCING DEMOLITION, CONTRACTOR SHALL IDENTIFY WITH OWNER ANY EQUIPMENT TO BE RETURNED TO THE OWNER AFTER DEMOLITION. ALL OTHER DEBRIS SHALL BE DISPOSED OF BY THIS CONTRACTOR IN ACCORDANCE WITH ALL APPLICABLE REGULATIONS.
 4. IT IS NOT THE INTENT TO SHOW EVERY PIPE OR EQUIPMENT, AND EXACT SIZES TO BE REMOVED IN THE DEMOLITION WORK. DRAWING INDICATES EQUIPMENT, PIPING, DUCTWORK, AND SIZES DIAGRAMMATICALLY. EXACT LOCATION AND SIZE OF ALL COMPONENTS ARE TO BE DETERMINED IN THE FIELD AND BY THE ACTUAL BUILDING CONDITIONS BY THE CONTRACTOR. ALL EXISTING MECHANICAL EQUIPMENT AND PIPING NOT BEING USED FOR THE NEW SYSTEM SHALL BE REMOVED AND DISPOSED OF, WHETHER NOTED OR NOT.
 5. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE REMOVING AND DISPOSING OF ALL EXISTING MECHANICAL EQUIPMENT, DUCTWORK, PIPING, VALVES, CONTROLS, AND ELECTRICAL AS SHOWN ON DRAWINGS, EXCEPT WHERE NOTED OTHERWISE.

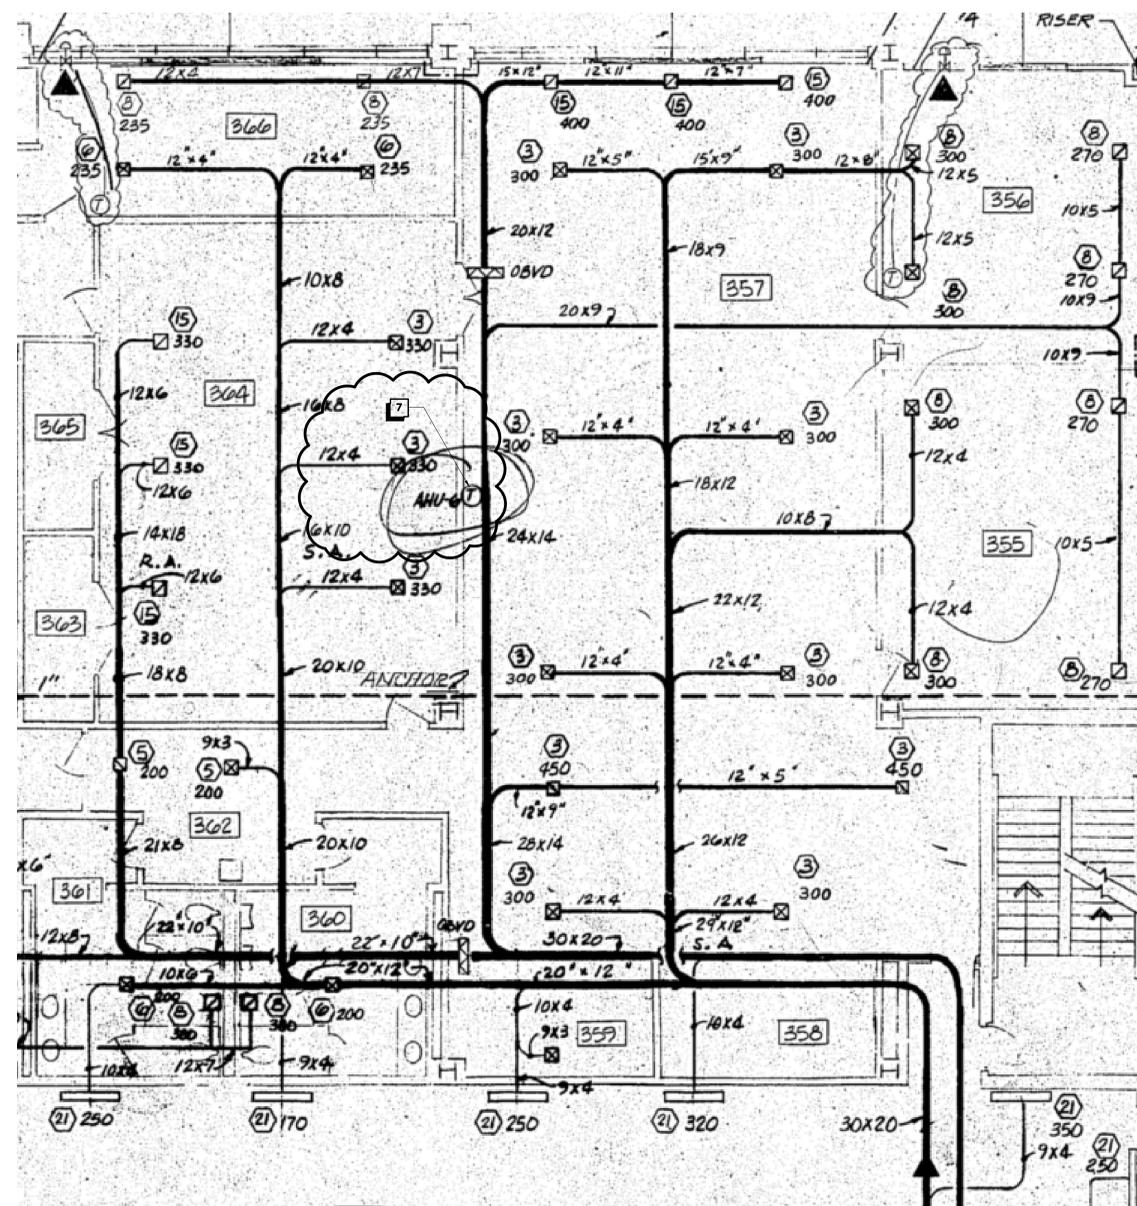

PARTIAL THIRD FLOOR PLAN - HVAC
NO SCALE

Date	Revision/Issue

