STATE OF RHODE ISLAND AND PROVIDENCE PLANTATIONS

Department of Administration
DIVISION OF PURCHASES
One Capitol Hill
Providence, RI 02908-5855

Tel: (401) 574-8100
Fax: (401) 574-8387
Website: www.purchasing.ri.gov

June 3, 2013

ADDENDUM NUMBER ONE
RFQ # 7467368

TITLE: Purchase and Install Generator and Transfer Switch-Warwick Armory

Closing Date and Time: 6/14/13 at 1:30 PM (Note Change)

Per the issuance of this <u>ADDENDUM #1 (total of 4 pages)</u> the following change(s) are noted:

Please be advised the Bid Closing Date and Time has been extended:

From: 6/7/13 at 10:30 AM
To: 6/14/13 at 1:30 PM

[X] **Specification Change /Addition / Clarification**

This addendum posts sign in sheet from mandatory pre bid held 5/29/13 at 11am.

This addendum changes bid closing date and time as noted above.

Please monitor State Purchasing web site for revised specifications for generator.

Attached is bollard specification. Total of four (4) bollards will be required.

All vendor employees/representatives must be cleared through a BCI check before being authorized to work in the building. All BCIs to be performed at the vendor's expense.

Awarded vendor will be required to notify agency 24 hours prior to working on site to insure representative of agency is present.

STATE OF RHODE ISLAND AND PROVIDENCE PLANTATIONS

Department of Administration
DIVISION OF PURCHASES
One Capitol Hill
Providence, RI 02908-5855

Tel: (401) 574-8100
Fax: (401) 574-8387
Website: www.purchasing.ri.gov

June 3, 2013

ADDENDUM NUMBER ONE
RFQ # 7467368

TITLE: Purchase and Install Generator and Transfer Switch-Warwick Armory

Closing Date and Time: 6/14/13 at 1:30 PM (Note Change)

Vendor will give agency 24 hour notice prior to shutting down any power in order to connect/disconnect service.

Permits will be required. Contractor is responsible for complying with all federal and state codes.

State of Rhode Island
Division of Purchases
One Capitol Hill
Providence, RI 02908

"MANDATORY" PRE-BID CONFERENCE SIGN IN SHEET

Mandatory Pre-bid Conference: Any vendor who intends to submit a bid proposal in response to this solicitation must have its designated representative attend the mandatory pre-bid conference. The representative must register at the pre-bid conference and disclose the identity of the vendor whom he/she represents. Because attendance at the pre-bid conference is mandatory, a vendor's failure to attend and register at the pre-bid conference shall result in disqualification of the vendor's bid proposal as non-responsive to the solicitation.

Purchasing Representative CADORET
Mandatory Pre-bid START TIME 11:00
Mandatory Pre-bid END TIME: 11:23

BID NUMBER: 7467368
BID TITLE: PURCHASE AND INSTALL GENERATOR AND TRANSFER SWITCH - WARWICK ARMORY
PRE-BID DATE AND TIME: 5/29/13 11AM

	COMPANY NAME	COMPANY REPRESENTATIVE	ADDRESS	CONTACT E-MAIL	CONTACT PHONE NUMBER	CONTACT FAX NUMBER	PROPOSAL SUBMITTED (For Purchasing Use Only)
1	Nolin Elec	Joe Therien	N Scituate RI	joe@nolinelectrica.net	401-640-0548		
2	CALSON CORP	STEVE CAPOZZOLI	34 OAKDALE AVE JOHNSTON	STEVEC@CALSONCORP.com	401-272-1100	401-272-0035	
3	FALL RIVER ELECTRICAL ASSOCIATES CO. INC	ALFRED D. MYETTE	74 CORNEAU ST FALL RIVER MA 02721	almyette@frea.biz	508 675-0523	508 674-2826	
4	Allied Elec Corp	Andrew Giuliano	538 Charles St	Andrew@All.adelectricalgroup.com	351-8800	351-8811	
5	Carl Hyllestun	MILITIA OF STATE					
6	PURCHASING	DAVID CADORET					
7	NAPCO, INC	Dave Wildgoose	76 Grandview LR	Ldwildgoose@gmail.com	641-9159	732-1776	
8							
9							
10							
11							
12							
13							

Updated 4/30/13

** VENDOR: PLEASE SUBMIT A BUSINESS CARD IF AVAILABLE

STANDARD DETAILS & SPECIFICATIONS

SUBJECT: Specifications for the installation of bollards for private fire protection equipment, generators, and fuel tanks

BOLLARD DETAIL

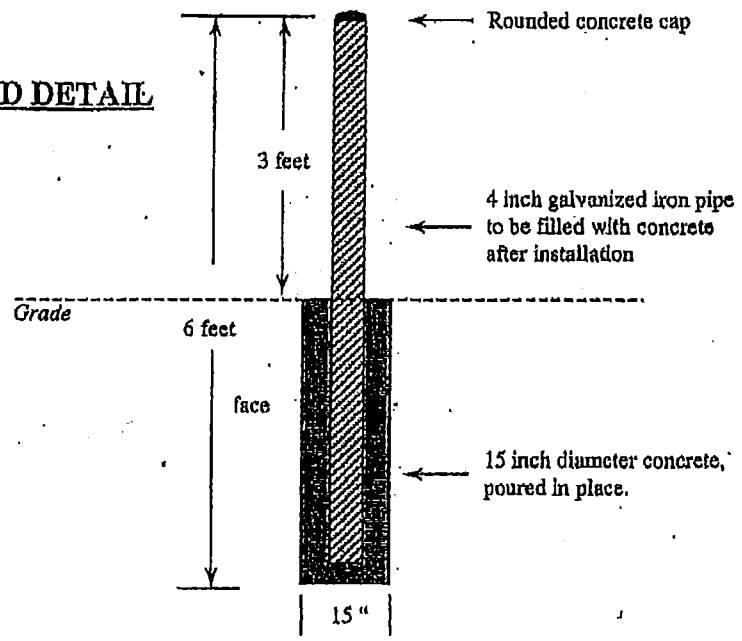

HYDRANT POST LOCATIONS

Bollards shall be three (3) feet minimum from the face of fire hydrant. All orifices shall be unobstructed.

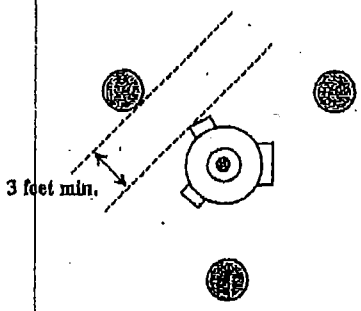

GENERATOR/FUEL TANK POST LOCATIONS

Bollards shall be five (5) feet minimum from the face of fire hydrant.

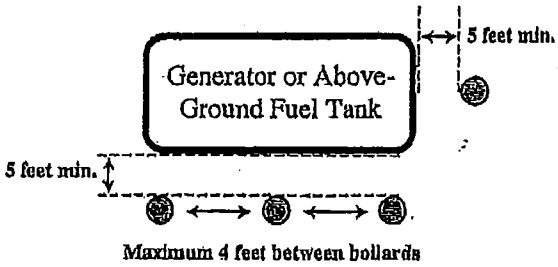

3000 PSI concrete will be used; bollards will be covered with safety yellow bollard sleeves. Due to location restrains on-site modification to specifications can be authorized by the construction supervisor