



STATE OF RHODE ISLAND AND PROVIDENCE PLANTATIONS

Department of Administration
DIVISION OF PURCHASES
One Capitol Hill
Providence, RI 02908-5855

Tel: (401) 574-8100
Fax: (401) 574-8387
Website: www.purchasing.ri.gov

August 6, 2014

ADDENDUM NUMBER TWO
RFQ # 7548779

TITLE: Furnish and Install Generator for Zambarano Hospital Waste Water Treatment Plant

Closing Date and Time: 8/14/14 at 10:00AM

Per the issuance of this ADDENDUM #2 (7 pages) the following is noted:

Attached is concrete pad detail.

Attached are notes from the engineer in response to questions asked at the pre bid.

Attached is a revised bid form.

In addition, the buyer went over the following:

This was a mandatory pre bid.

Bid surety is required. The awarded vendor will have to provide a 100% payment and performance bond.

Questions were being accepted on line until 7/31/14 at 5pm. Email address is in the solicitation. (Note: There were no questions submitted on line.)

Within the specifications manual there are 2 pages entitled INVITATION FOR BIDS. These pages are obsolete and not applicable.

This is a public works project and requires a public copy as outlined in bid specifications.

Note the liquidated damages as outlined in the bid form.

Note bid clauses as they pertain to public works projects.

This is a prevailing wage project. Certification form in bid package acknowledging prevailing wage should be submitted with bid proposal.

END OF QUESTIONS

Solicitation #:7548779
Solicitation Title: New Generator Installation for Zambarano Hospital
Waste Water Treatment

DOCUMENT 004113 - BID FORM

To: The State of Rhode Island Department of Administration
Division of Purchases, 2nd Floor
One Capitol Hill, Providence, RI 02908-5855

Bidder: _____
Legal name of entity

Address (street/city/state/zip)

Contact name Contact email

Contact telephone Contact fax

1. BASE BID PRICE

The Bidder submits this bid proposal to perform all of the work (including labor and materials) described in the solicitation for this Base Bid Price (*including the costs for all Allowances, Bonds, and Addenda*):

\$ _____
(base bid price *in figures* printed electronically, typed, or handwritten legibly in ink)

(base bid price *in words* printed electronically, typed, or handwritten legibly in ink)

In addition to the contractors bid price to perform the work specified in the contract document the bid shall include a contingency allowance of \$25,000.00 as indicated in Section 012000, Price and Payment procedures.

• **Bonds**

The Base Bid Price ***includes*** the costs for all Bid and Payment and Performance Bonds required by the solicitation.

• **Addenda**

The Bidder has examined the entire solicitation (including the following Addenda), and the Base Bid Price ***includes*** the costs of any modifications required by the Addenda.

Solicitation #:7548779
Solicitation Title: New Generator Installation for Zambarano Hospital
Waste Water Treatment

All Addenda must be acknowledged.

Addendum No. 1 dated: _____

Addendum No. 2 dated: _____

Addendum No. 3 dated: _____

2. CONTRACT TIME

The Bidder offers to perform the work in accordance with the timeline specified below:

- Start of construction: September 2014
- Substantial completion: 26 Weeks after issuance of State of R.I. PO
- Final completion: 28 Weeks after issuance of State of R.I. PO

5. LIQUIDATED DAMAGES

The successful bidder awarded a contract pursuant to this solicitation shall be liable for and pay the State, as liquidated damages and not as a penalty, the following amount for each calendar day of delay beyond the date for substantial completion, as determined in the sole discretion of the State: \$ 100.00 per calendar day.

Solicitation #:7548779

Solicitation Title: New Generator Installation for Zambarano Hospital
Waste Water Treatment

This bid proposal is irrevocable for 60 days from the bid proposal submission deadline.

If the Bidder is determined to be the successful bidder pursuant to this solicitation, the Bidder will promptly: (i) comply with each of the requirements of the Tentative Letter of Award; and (ii) commence and diligently pursue the work upon issuance and receipt of the purchase order from the State and authorization from the user agency.

The person signing below certifies that he or she has been duly authorized to execute and submit this bid proposal on behalf of the Bidder.

BIDDER

Date: _____

Name of Bidder

Signature in ink

Printed name and title of person signing on behalf
of Bidder

Bidder's Contractor Registration Number



CREATIVE ENVIRONMENT CORP.

CONSULTING ENGINEERS
50 OFFICE PARKWAY
EAST PROVIDENCE, RI 02914

120 MAPLE STREET, SUITE 304
SPRINGFIELD, MA 01103

August 6, 2014

Mr. David A Cadoret
Chief Buyer
Division of Purchases
State of Rhode Island
One Capitol Hill, 2nd Floor
Providence, RI 02908

RE: New Generator for Zambarano Hospital
Waste Water Treatment Facility Addendum #1
Solicitation No. 7548779
CEC Project No. 20130146

Dear Mr. Cadoret:

The following addendum items shall be included as part of the contract documents for the above reference project.

Specifications:

Item #1:

The attached bid form shall be used instead of the bid form issued with the specifications.

Drawings:

Item #1:

The contractor shall contact Digsafe prior to trenching.

Item #2

See sketch SKE-1 for the concrete generator pad detail.

Item #3

Space will be provided near the laundry building for a contractor trailer if needed.

Item #4

The battery charger and block heater circuits can be combined in the same conduit.

Item #5

The owner will move the cabinet in the brick building to allow wall space for installing the automatic transfer switch.

Item #6

The contractor will be given a key to gain access to the site. The contractor should check in each day at the office located in the small brick building. The working hours are 7:00 am to 3:30 pm Monday thru Friday.

*Mr. David A. Cordet
Zambarano Hospital Addendum #1
August 6, 2014
Page 2*

Item #7

Electrical shutdowns will be allowed from 12:00 to 3:30 with prior notice of at least 5 days.

Item #8


Chain link fence required to be removed and shall be replaced by the contractor to the satisfaction of the Owner.

Item #9

A concrete pumper shall be provided by the contractor as needed to pour the concrete duct bank.

END OF ADDENDUM #1

NOTE:
 PROVIDE ANCHOR BOLTS AS REQUIRED
 BY GENERATOR MANUFACTURER

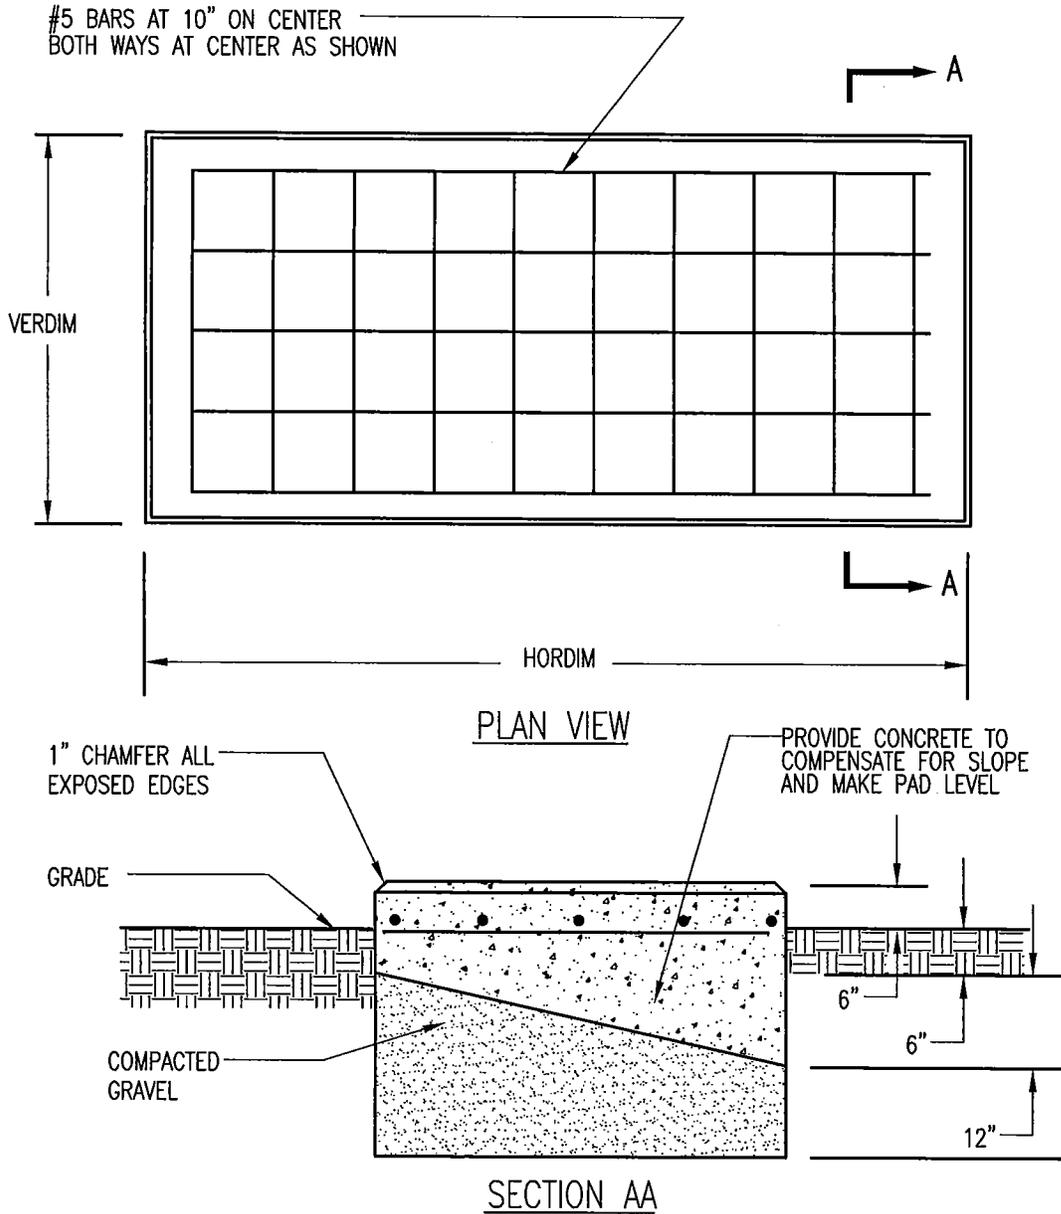

GENERATOR PAD DETAIL

NTS



HVAC • ELECTRICAL • PLUMBING
 • FIRE PROTECTION •

50 OFFICE PARKWAY
 EAST PROVIDENCE, RI 02914
 P: 401.438.7733
 F: 401.438.7620
 WWW.CEC-ENGINEERING.COM

PROJECT TITLE

NEW GENERATOR FOR ZAMBARANO
 HOSPITAL
 WASTE WATER TREATMENT FACILITY

SHEET CONTENTS:

GENERATOR PAD DETAIL

PROJECT No.
 20130146

SCALE:
 1/8" = 1'-0"

DRAWN BY:
 FB

CHECKED BY:
 SC

DATE:
 8-6-14

DWG. REFERENCE

E1.1

SKETCH No.

SKE1.1