



STATE OF RHODE ISLAND AND PROVIDENCE PLANTATIONS

Department of Administration
DIVISION OF PURCHASES
One Capitol Hill
Providence, RI 02908-5855

Tel: (401) 574-8100
Fax: (401) 574-8387
Website: www.purchasing.ri.gov

March 19, 2015

ADDENDUM NUMBER THREE

RFQ # 7549344

**TITLE: Freshwater Access Site Improvements, Beach Pond, Exeter, RI,
DEM**

Closing Date and Time: 3/26/15 at 2:00 PM

Per the issuance of this ADDENDUM #3 (4) pages, including this cover sheet)



Specification Change /Addition / Clarifications

**Please review and include the attached Addendum Number Three in your
bid response.**

NOTICE OF ADDENDUM NUMBER THREE (3)

TO

State of Rhode Island
DEM-Planning and Development Contract No. 11-14
Solicitation Number 7549344
Freshwater Access Site Improvements, Beach Pond
Exeter, Rhode Island

DATE of ADDENDUM: March 18, 2015

The contract documents are hereby modified to include this document as if fully attached thereto.

Response to Questions:

Q1) The plans (Sheet L-1) call for proposed walkways. Are they included in this contract? If so what type of walkways.

The proposed paths shown are natural ground. Existing rip-rap and boulders shall be cleared from the proposed pathway.

Q2) The plans (Sheet L-1) calls for new guardrail. What type of guardrail?

The proposed guardrail shown on Sheet L-1 is to be excluded from the contract.

Q3) Does the existing gravel parking area need to be regraded?

The parking area shall be regraded only as necessary to leave it in good condition free from potholes and depressions upon completion of the project.

Q4) Please refer to Sheet C2 (3 of 12). Please provide a detail of the proposed posts with galvanized chains.

Attached

Q5) Please refer to Sheet S5 (10 of 12). Pile caps are specified to be fiberglass pile caps by Cheyenne Manufacturing Inc. Piles are 12" diameter but the minimum size pile cap manufactured by Cheyenne is 13". Is this acceptable?

Product may be substituted with an "or equal" from another marine product manufacturer. Equivalent product should be 1/8" min. wall thickness with 60-degree cone. Since the 12-inch (nominal) pile diameter may vary at final cut-off, the following installation guideline are recommended:

After all pilings have been cut to the appropriate cut-off elevation, measure the top of each piling at its widest point to determine which size cap is needed. Should the measurement fall between two sizes, select the next larger size. Pre-drill each cap with (4) holes evenly spaced around the perimeter and install the cap with stainless steel screws or ring shank nails. Install the fastener only until it is flush with the cap. Do not deform the cap by driving the fastener

tight against the pile.

Q6) Please refer to Sheet S3 (8 of 12), regarding the proposed steel guide rail.



a. Does the guide rail have to be galvanized?

No

b. The guide rail plan view shows a 3'x2'x1/2" plate (5) per rail. The comprehensive guide rail plan shows 3 per rail. Which is correct?

There should be (3) 3' x 2' x 1/2" plates per guide rail, total plates 15.

******* END OF ADDENDUM NUMBER 3 *******

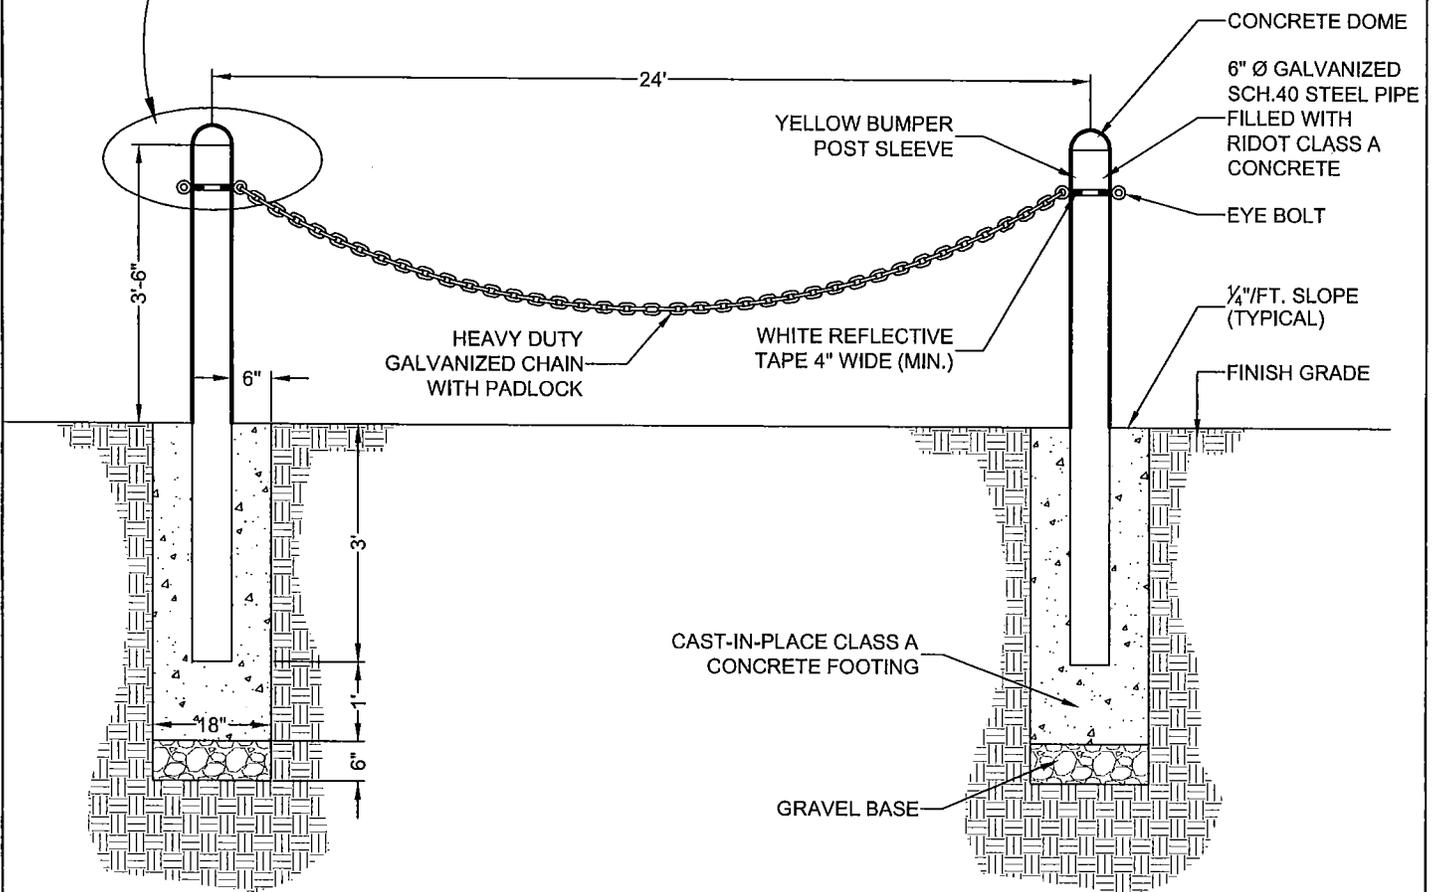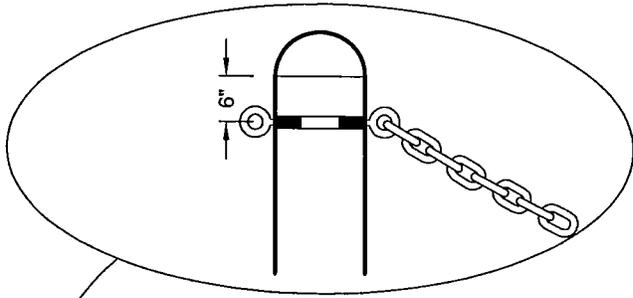

RI DEM DIVISION
 OF PLANNING &
 DEVELOPMENT
 235 PROMENADE
 ST. PROVIDENCE,
 RI 401-222-2776

ADDENDUM #3
 FRESHWATER ACCESS
 SITE IMPROVEMENTS
 BEACH POND, EXETER
 P&D 11-14

DRAWN BY: JJC

SCALE: 1" = 5'

DATE: MARCH, 2015

BOLLARD DETAIL

SK-4

SHEET 1 OF 1